

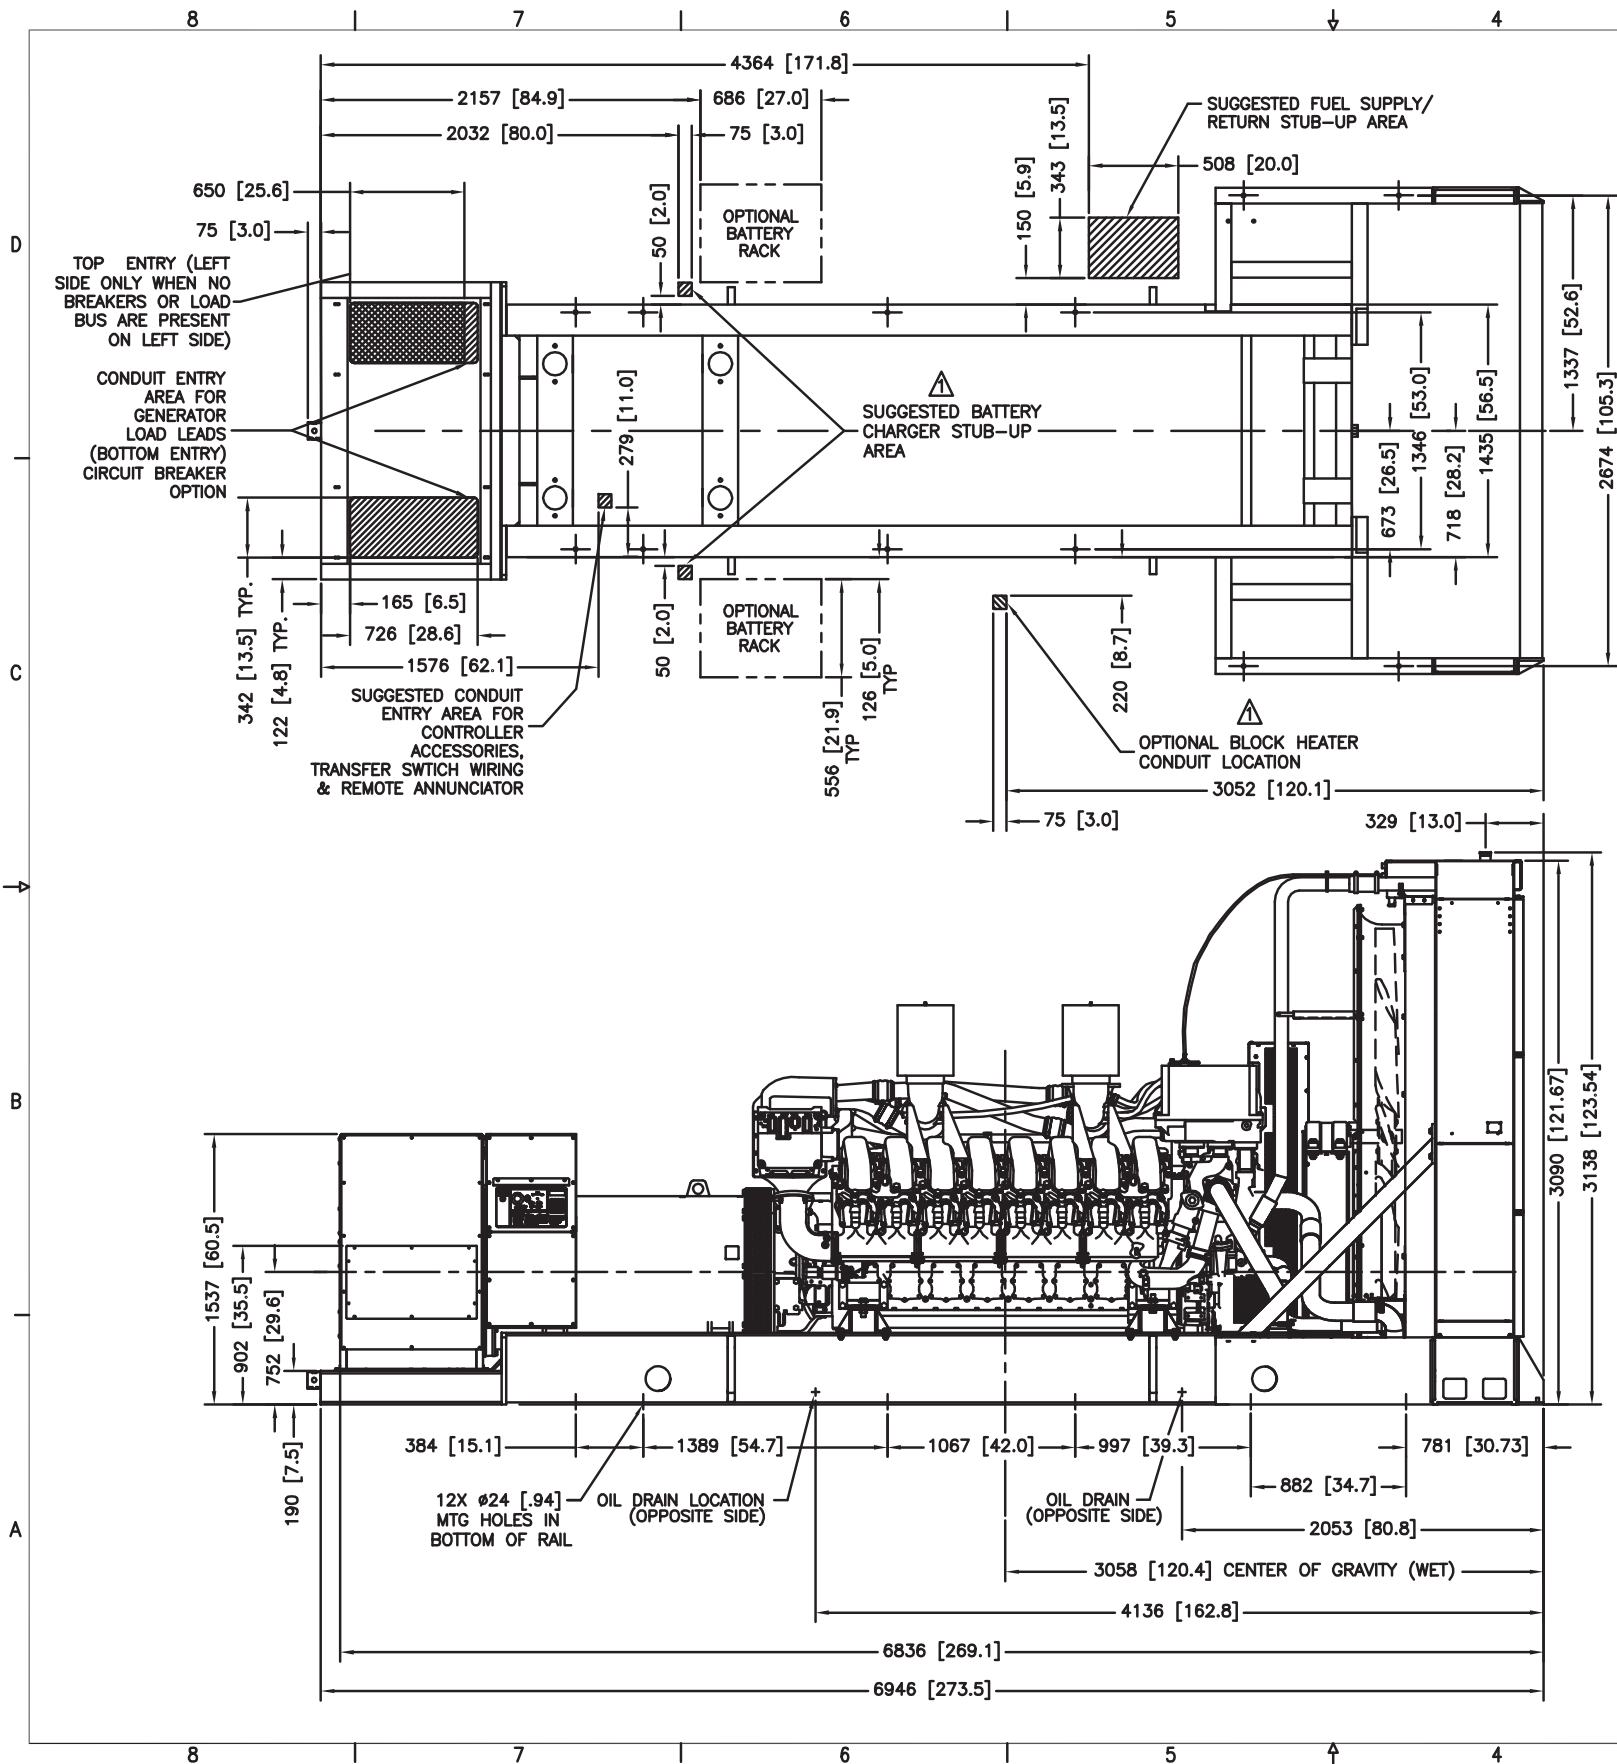


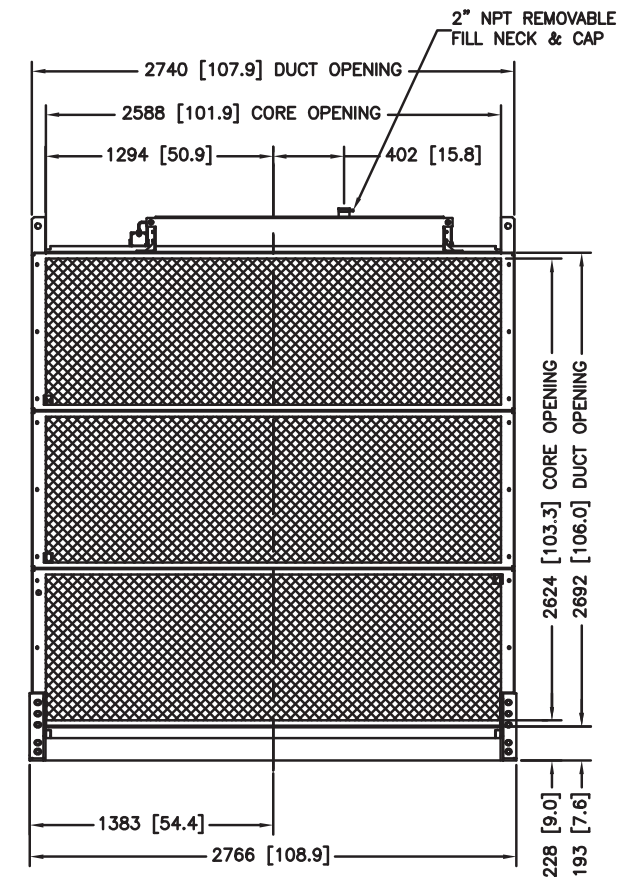

INSTALLATION NOTE
IF SUBBASE FUEL TANK AND/OR SOUND HOUSING IS USED, REFER TO SUBBASE FUEL TANK ADV TO DETERMINE MOUNTING LOCATIONS.

REV	DATE	REVISION	BY
-	6-17-11	NEW DRAWING [91724-6]	DW

INSTALLATION NOTE
IF IBC CERTIFICATION IS REQUIRED SEE SEISMIC ADV FOR INSTALLATION INSTRUCTIONS

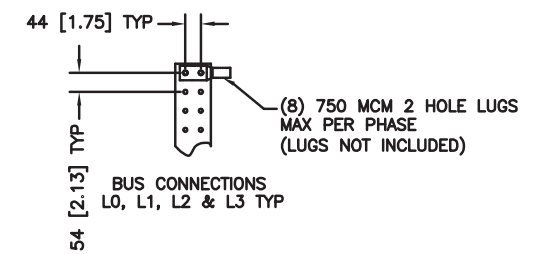

⚠ WHEN SUBBASE TANK IS USED, CONDUIT LOCATION SHOULD BE ALTERED ACCORDINGLY, OR IN STUB-UP AREA FOR SUBBASE TANK. REFER TO SUBBASE ADV.

NOTE:
MAXIMUM WET WEIGHT OF GENSET
LESS ACCESSORIES:
16,375 KG [36,100 LBS]

METRIC CAD FILE

NOTE: DIMENSIONS IN [] ARE INCH EQUIVALENTS.


2250 MODEL 50/60 HZ
7M4056, 7M4058, 7M4376
RECONNECTABLE, 380V, 3300V, 4160V ALTERNATORS
40C & 50C COOLING SYSTEM
SERIES 4000, TIER II


KOHLER CO.
POWER SYSTEMS, KOHLER, WI 53044 U.S.A.
THIS DRAWING, IN DESIGN AND DETAIL, IS KOHLER CO. PROPERTY AND
MUST NOT BE USED EXCEPT IN CONNECTION WITH KOHLER CO. WORK.
ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED.





DIMENSION PRINT
2250 KW SERIES 4000

DESIGN	DW	DATE	6-17-11
DESIGNED	DW	DATE	6-17-11
APPROVED	JGZ	DATE	6-17-11

ADV-8416

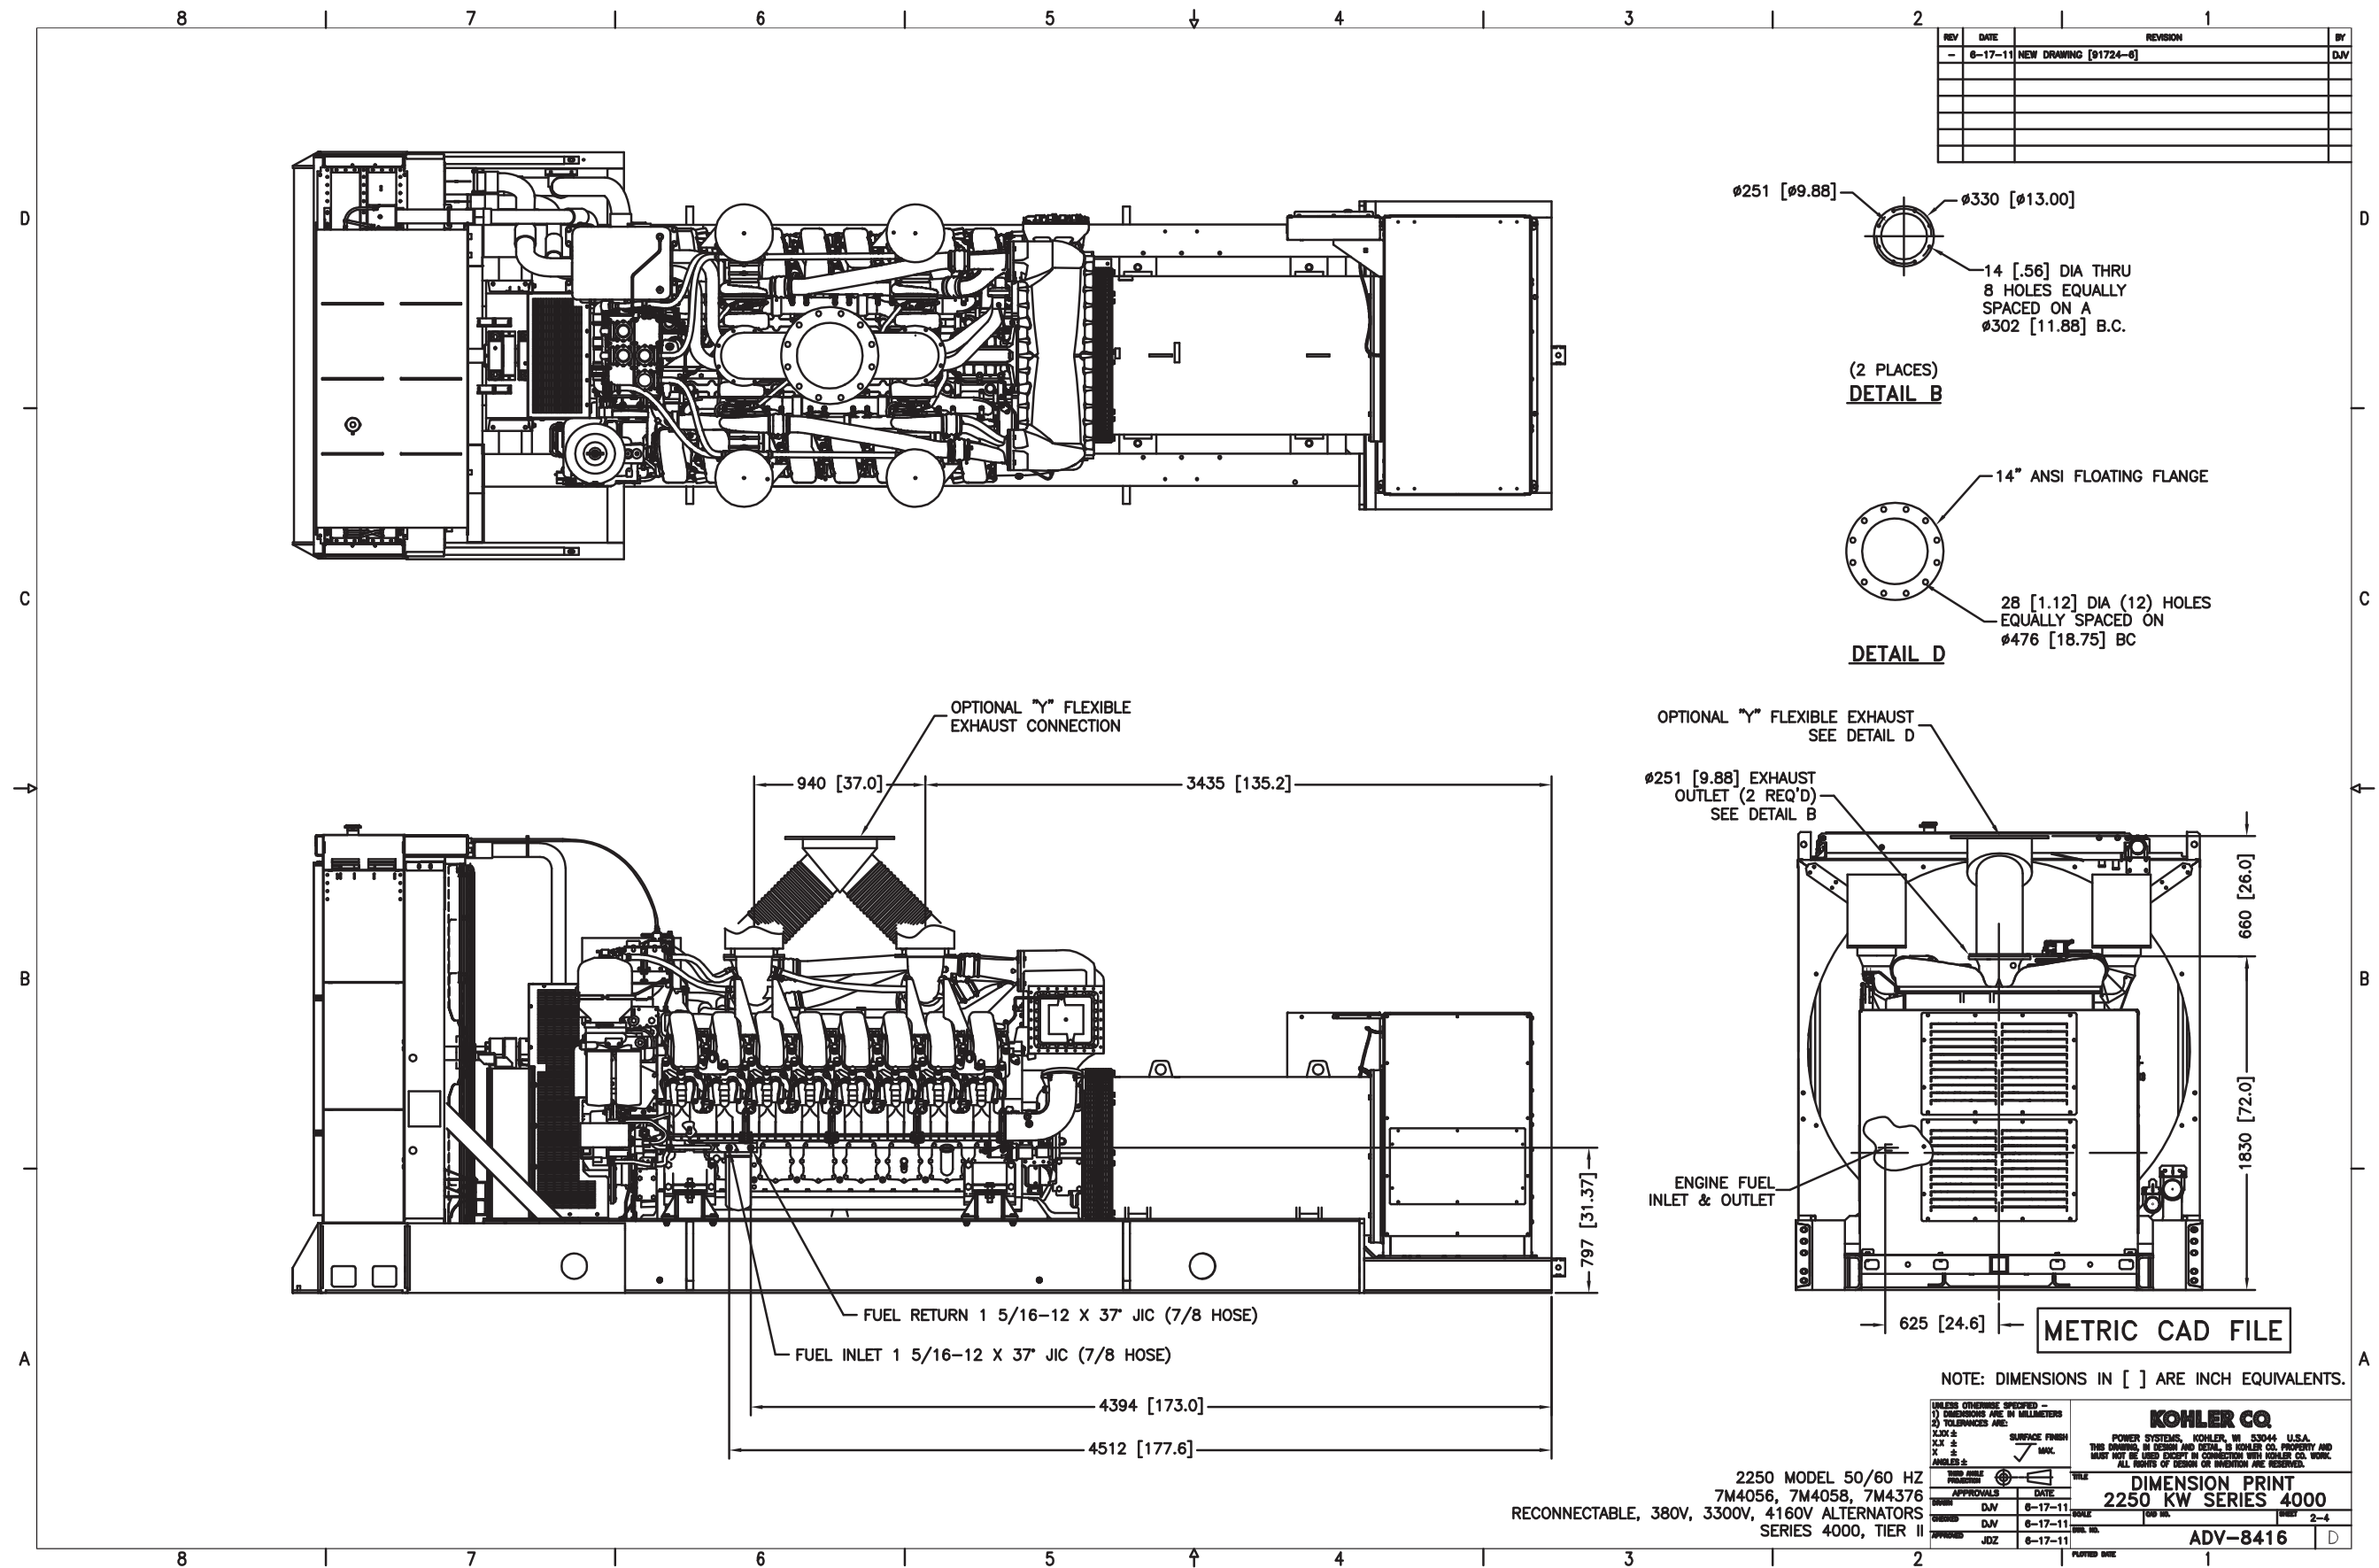

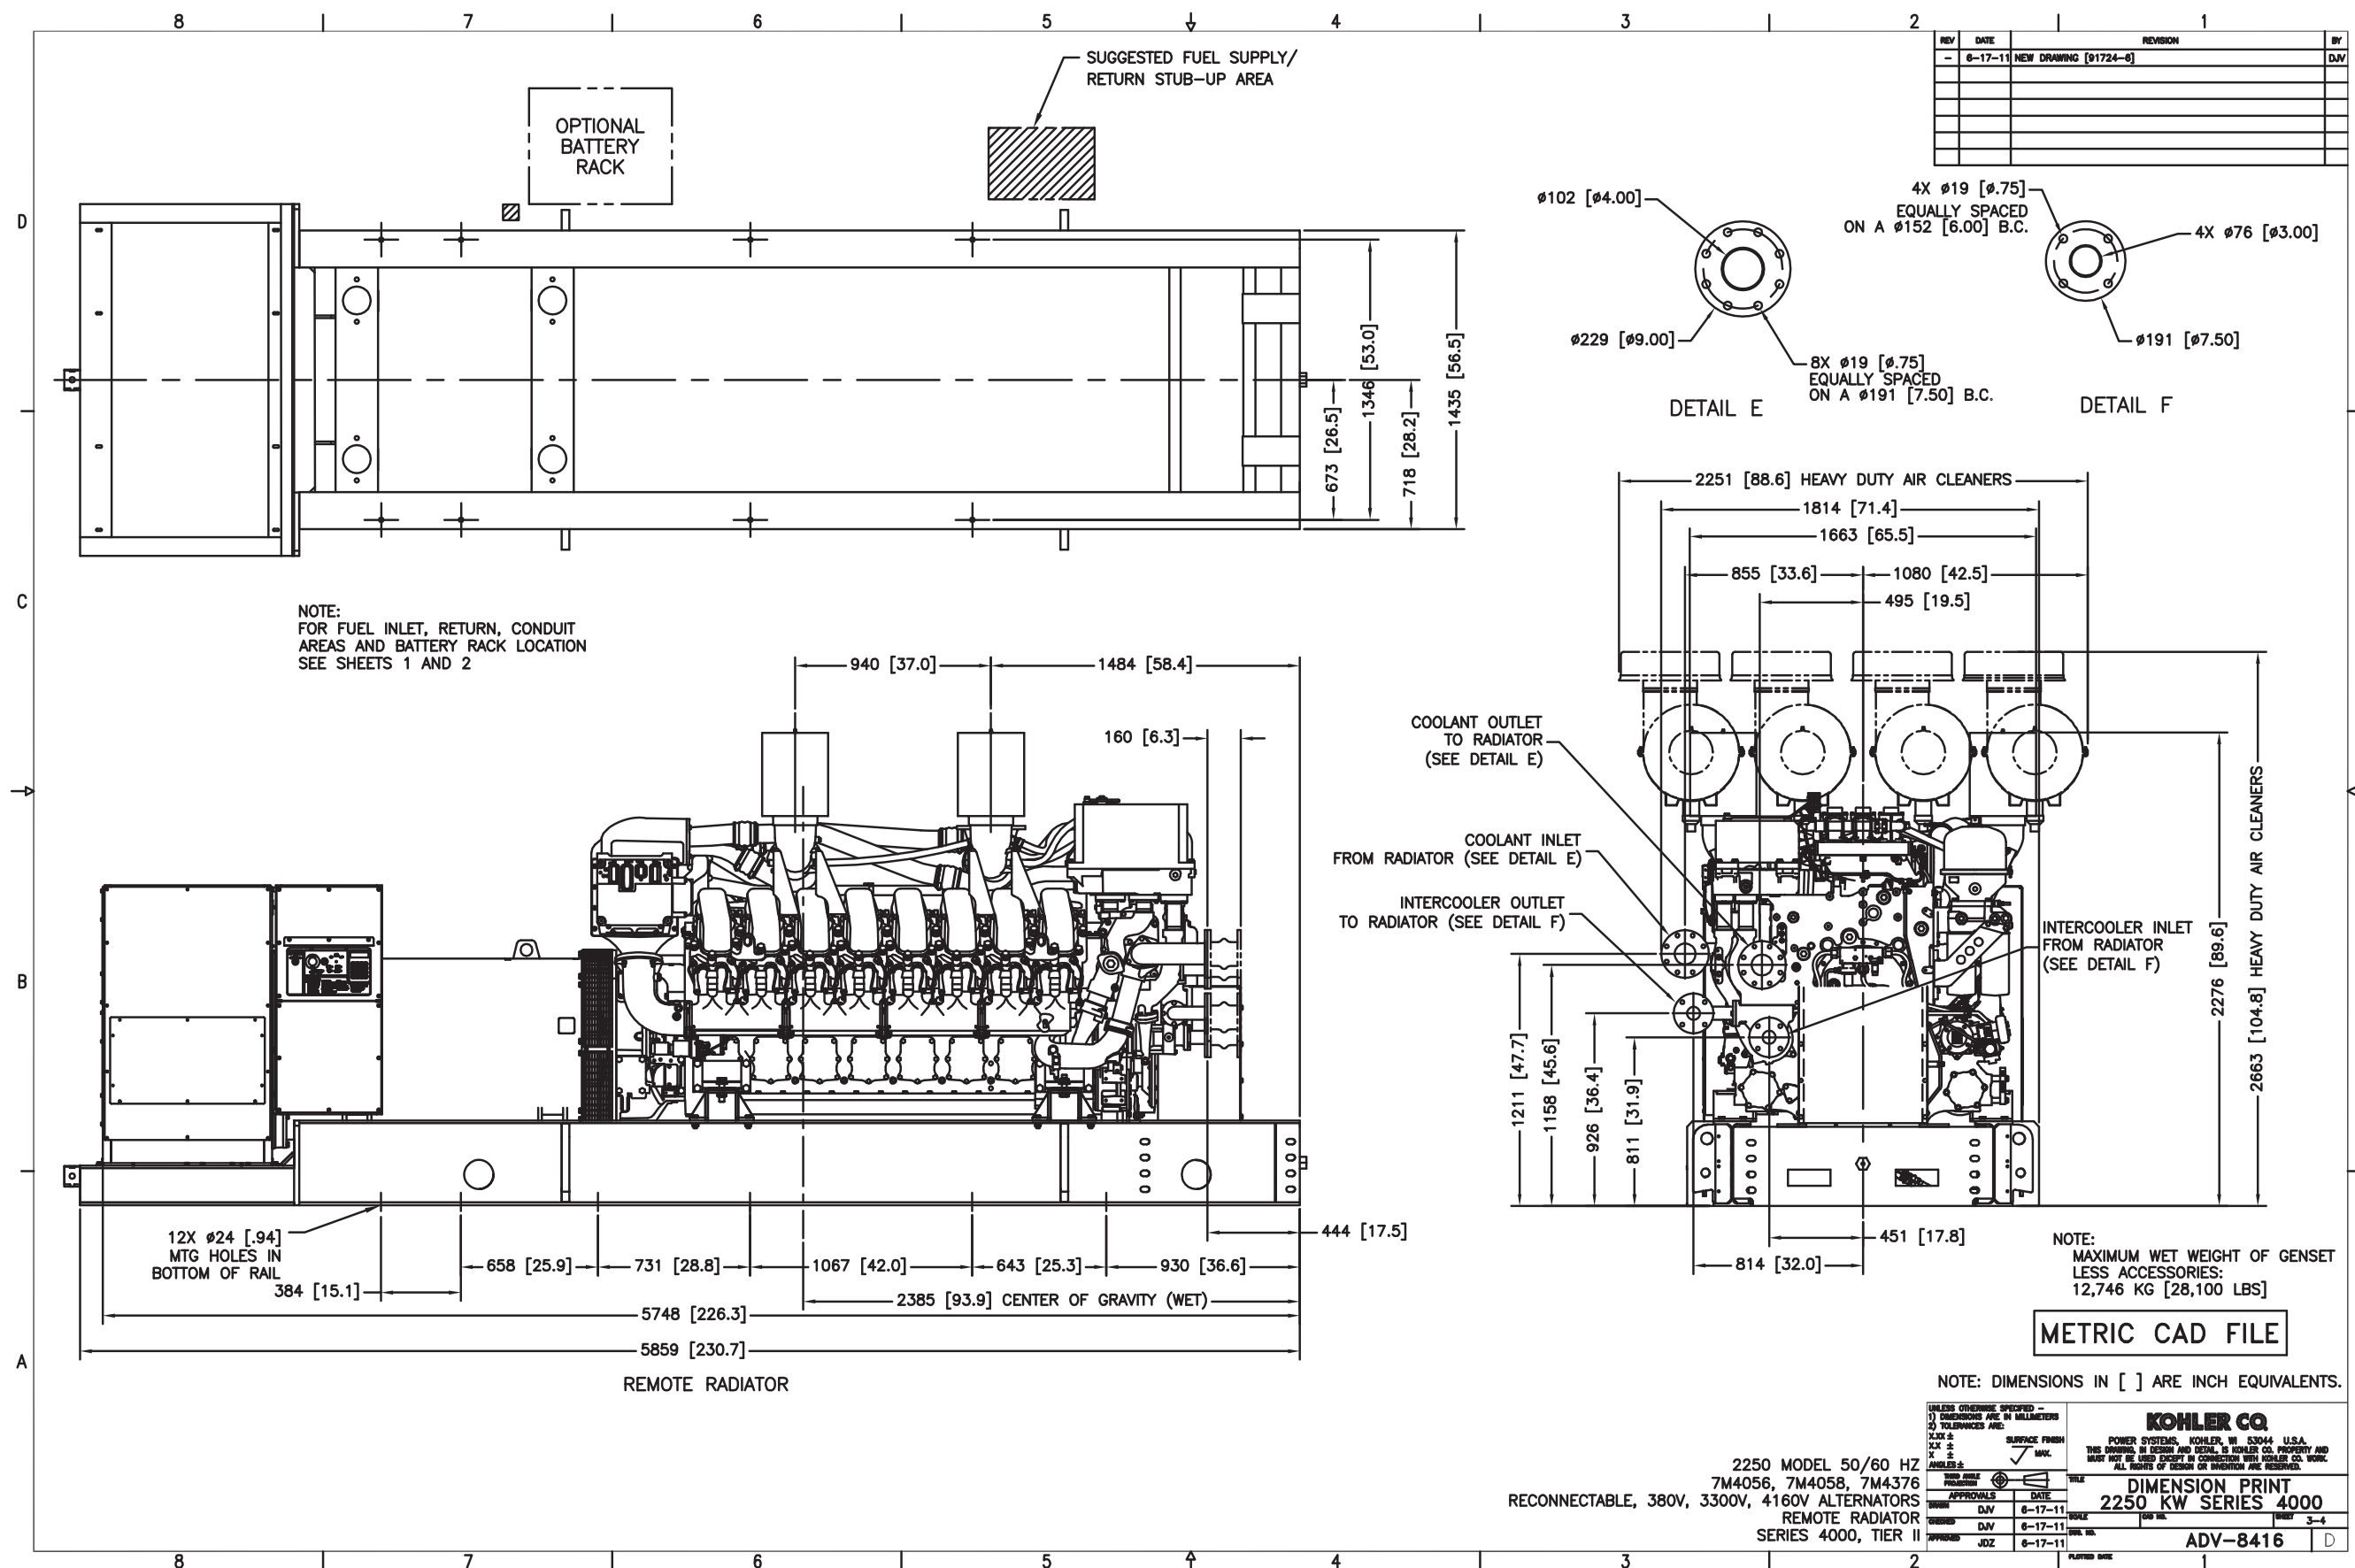

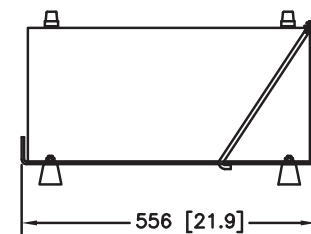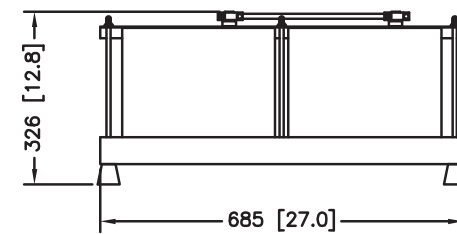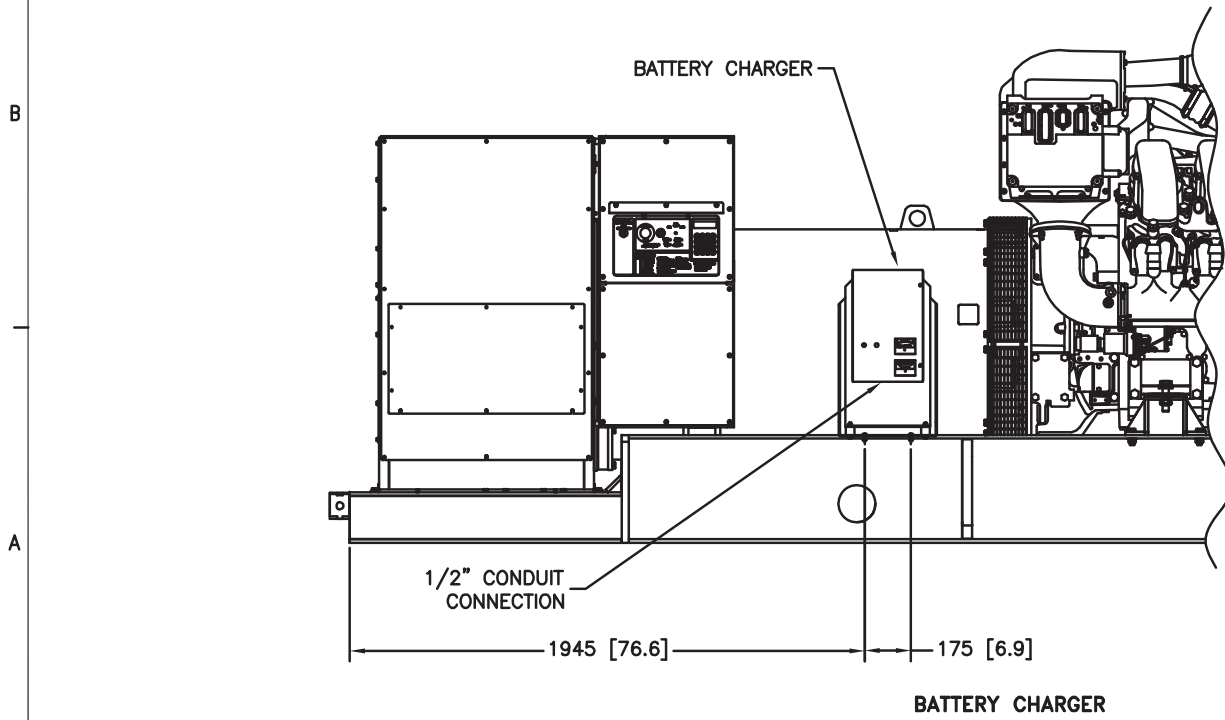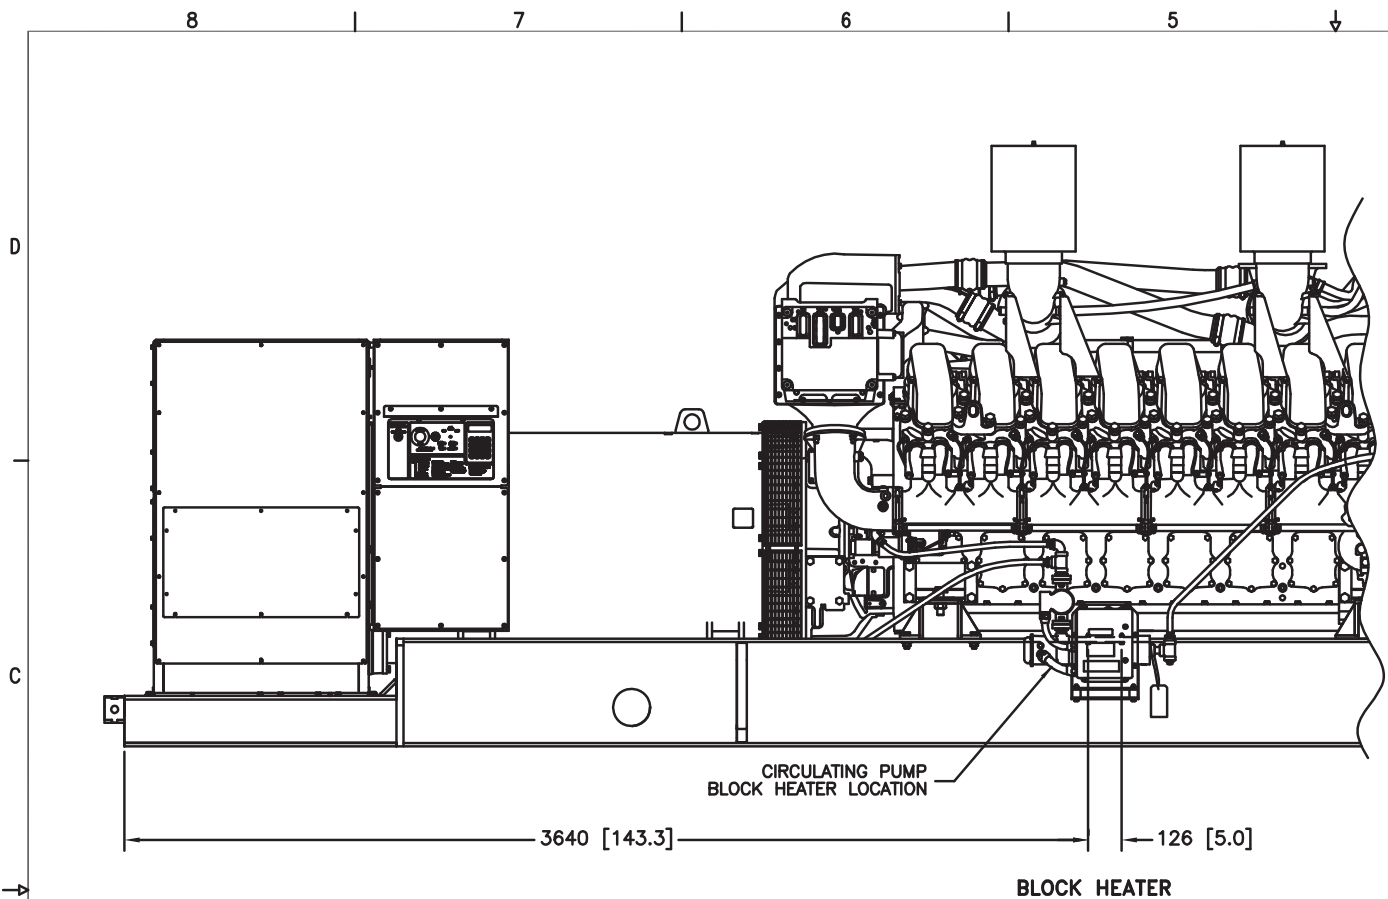

BATTERY & BATTERY RACK
SCALE: 2X

METRIC CAD FILE

NOTE: DIMENSIONS IN [] ARE INCH EQUIVALENTS.

2250 MODEL 50/60 HZ
7M4056, 7M4058, 7M4376
RECONNECTABLE, 380V, 3300V, 4160V ALTERNATORS
SERIES 4000, TIER II

UNLESS OTHERWISE SPECIFIED - 1) DIMENSIONS ARE IN MILLIMETERS 2) TOLERANCES ARE: X.XX ± X ± X/16 ±		SURFACE FINISH ✓ MAX.	
THIRD ANGLE PROJECTION		SCALE	
APPROVALS		DATE	
DRAWN	DJV	6-17-11	
CHECKED	DJV	6-17-11	
APPROVED	JDZ	6-17-11	
KOHLER CO. POWER SYSTEMS, KOHLER, WI 53044 U.S.A. THIS DRAWING, IN DESIGN AND DETAIL, IS KOHLER CO. PROPERTY AND MAY NOT BE USED EXCEPT IN CONNECTION WITH KOHLER CO. WORK. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED.		DIMENSION PRINT 2250 KW SERIES 4000	
ADV-8416		D	